

bre

**Weathertightness test to  
BS 6375: Part 1: 2009 on  
a Smart Architectural  
Aluminium Slide 2000  
sliding patio door**

Prepared for: Mr. D. White


Smart Architectural Aluminium

02 December 2012

Test report number 282473-4



0578

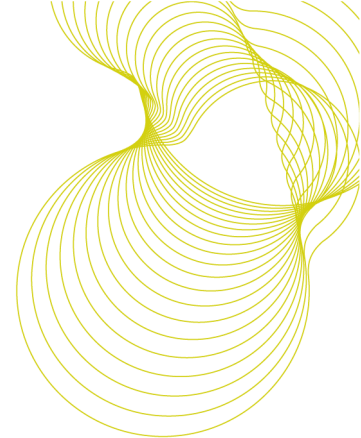

**Tested on behalf of BRE by:**

---

Name Malcolm Pound  
Position Senior Consultant and Laboratory Manager, Construction, Building Technology  
Date 15 November 2012

Signature *M. C. Pound*

---

**Prepared on behalf of BRE by:**

---

Name Malcolm Pound  
Position Senior Consultant and Laboratory Manager, Construction, Building Technology  
Date 02 December 2012

Signature *M. C. Pound*

---

**Approved on behalf of BRE**

---

Name Dr. Paul Blackmore  
Position Associate Director, Construction, Building Technology  
Date 03 December 2012

Signature *P. Blackmore*

---

BRE  
Garston  
WD25 9XX  
T + 44 (0) 1923 664000  
F + 44 (0) 1923 664010  
E [enquiries@bre.co.uk](mailto:enquiries@bre.co.uk)  
[www.bre.co.uk](http://www.bre.co.uk)


BRE is not UKAS accredited to make opinions and interpretation. Any opinions and interpretations included as part of this report are clearly marked as such.



0578


This report may only be distributed in its entirety and in accordance with the terms and conditions of the contract. Test results relate only to the items tested. BRE has no responsibility for the design, materials, workmanship or performance of the product or items tested. This report does not constitute an approval, certification or endorsement of the product tested.

This report is made on behalf of BRE. By receiving the report and action on it, the client – or any third party relying on it – accepts that no individual is personally liable in contract, tort or breach of statutory duty (including negligence).

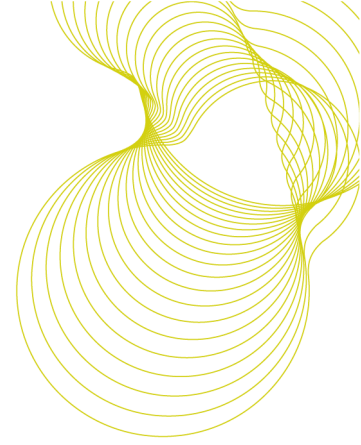

## Contents

|   |  |    |
|---|--|----|
| 1 | Introduction                           | 4  |
| 2 | Details of tests carried out           | 5  |
| 3 | Classification of results              | 6  |
| 4 | Test specimen                          | 7  |
| 5 | Test rig and preparatory procedures    | 8  |
| 6 | Summary of test results                | 9  |
| 7 | Conclusions                            | 10 |
| 8 | References                             | 11 |
|   | ANNEX A. Weathertightness test results | 12 |

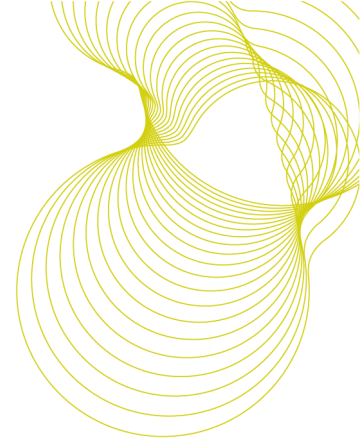

## 1 Introduction


At the request of Mr. D. White of Smart Architectural Aluminium, Technical Department, Arnolds Way, Yatton, Bristol, North Somerset, BS49 4QN, BRE issued proposal number 132241 on 21 September 2012. The proposal was accepted on 26 September and BRE tested a specimen Slide 2000 sliding patio door on the 15 November 2012.

The tests to methods in BS 6375: Part 1: 2009, BS EN 1026<sup>1</sup>, 1027<sup>2</sup> and 12211<sup>3</sup> measure the weathertightness of the specimen in terms of air permeability, watertightness and resistance to wind load respectively. Classification of the results is based on BS 6375: Part 1: 2009<sup>4</sup> and BS EN 12207<sup>5</sup>, 12208<sup>6</sup>, 12210<sup>7</sup>.

The tests on the specimen were carried out by Mr. M. C. Pound under the BRE Standard Terms and Conditions of Business for testing and to the UKAS BRE Specific Procedures Series F, as BRE Job number 282473 in project number CV5692. The tests were witnessed by:

Mr. D. White                      Technical Department, Smart Architectural Aluminium.

Mr. M. Walford                  Technical Department, Smart Architectural Aluminium.

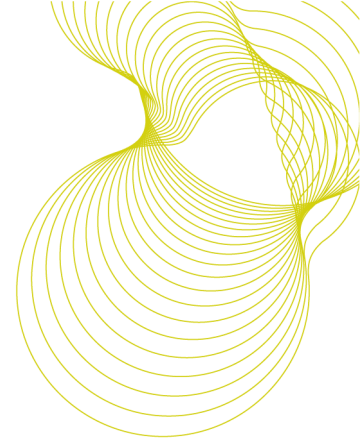

## 2 Details of tests carried out

BS 6375: Part 1: 2009 specifies that the air permeability test is performed under both positive and negative test pressures and that the average of the measurements defines the results. It also specifies that water tightness test method A is used and that deflections measured during the resistance to wind load test do not exceed 1/150 of the span. The weathertightness test comprised of three parts in the sequence:

1. Air permeability to BS EN 1026: 2000; by application of a series of test air pressure differentials across the specimen with measurement of the air permeability of it at each pressure step. The maximum positive and negative pressure differential was 600 Pa reached in pressure steps of 50, 100, 150, 200, 250, 300, 450 and 600 Pa.
2. Watertightness to BS EN 1027: 2000; by applying specified amounts of water spray to the outside face of the specimen while incrementally increasing the air pressure differential across it. The test pressure, time and position of any water penetration are recorded. The maximum positive air pressure differential was 300 Pa. Pressure (Pa)/time (min) steps were 0/15, 50/5, 100/5, 150/5, 200/5, 250/5 and 300/5.
3. Resistance to wind load to BS EN 12211: 2000; by application of a series of positive and negative test air pressures. Measurements and inspections are made to assess relative frontal deflection and resistance to damage from wind loads.

The resistance to wind load test includes a deflection test, a repeated pressure test and operational test, an air permeability test and finally a safety test. For the purpose of the resistance to wind load test three test pressures are defined:

P1 applied to measure the deflections of parts of the test specimen.


P2 50 cycles of pulsating pressure to assess performance under repeated wind loads.

P3 applied to assess the safety of the test specimen under extreme conditions.

The values of P1, P2 and P3 are related as follows:  $P2 = 0.5P1$ ,  $P3 = 1.5P1$ .

For these tests the values are:  $P1 = 1600$  Pa,  $P2 = 800$  Pa and  $P3 = 2400$  Pa.

**Note:** The repeat air permeability test is an integral part of the resistance to wind load test and its significance is as an indicator of damage that may occur during that test.

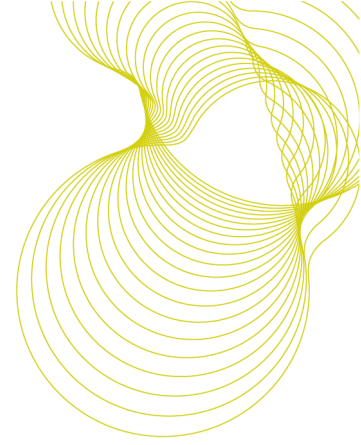

### 3 Classification of results

BS 6375: Part 1: 2009 classifies the results for products in the UK. For a door to be included in an exposure category the appropriate test pressures for air permeability, watertightness and resistance to wind shall be attained or exceeded. The relevant product standard BS EN 14351-1:2006<sup>8</sup> also states that classification of air permeability is based on the averages of the positive and negative air leakage values at each pressure step.

The specimen was tested to a UK exposure category of 1600 (1600 Pa). The classifications set in BS 6375: Part 1: 2009 for a UK exposure category of 1600 for windows are: Air permeability at Class 2/300 Pa when tested to 300 Pa or class 3 or 4 when tested to 600 Pa, water tightness at Class 5A/200 Pa and resistance to wind load at Class A4 at P1 1600 Pa, P2 800 Pa and P3 2400 Pa.

According to clause 4 of BS 6375: Part 1: 2009 'Doorsets that are tested and classified with a wind load greater than 1200 (Pa) shall be classified in accordance with BS EN 12207, 12208 and 12210'.

When averages of the measurements of air permeability per square metre and length of the opening joints on the specimen give rise to adjacent air permeability classes then the specimen shall be classified in the most favourable class (according to BS EN 12207 Clause 4.6).


The BS EN classifications are explained below:

**Air permeability:** BS EN 12207: 1999. The classification is based on a comparison of the air permeability of the test specimen related to both overall area and length of opening joint. There are four classes; Class 4 is applicable to the most airtight specimens while Class 1 describes those with most air leakage. To meet any class the measured air permeability of the specimen must not exceed the upper limit at any test pressure step in that class.

**Watertightness:** BS EN 12208: 2000. The classification is based on a comparison of the watertightness of the test specimen related to test pressures and duration of the test. There are nine classes; 1A/1B up to 9A for test pressures from 0 Pa to 600 Pa. For specimens that remain watertight over 600 Pa for 5 minutes a class Exxx is used. The xxx is the maximum test pressure e.g. 750 Pa. To meet any class the specimen must remain watertight for 5 minutes up to and at the test pressure set for that class.

**Resistance to wind load:** BS EN 12210: 1999. The classification is based on a comparison of the resistance to wind loads of the test specimen when subjected to test pressures P1, P2 and P3. There are five classes; 1 up to 5 for P1 test pressures from 400 Pa to 2000 Pa. For specimens that are tested to P1 pressures exceeding 2000 Pa a class Exxxx is used. The xxxx is the actual test pressure P1 used e.g. 2400 Pa. To achieve any class the resistance of the specimen to wind load must meet all the requirements for that class.


**Note:** This report has results for air permeability under positive and negative test pressures and a graph showing the average air permeability for them at each pressure step.

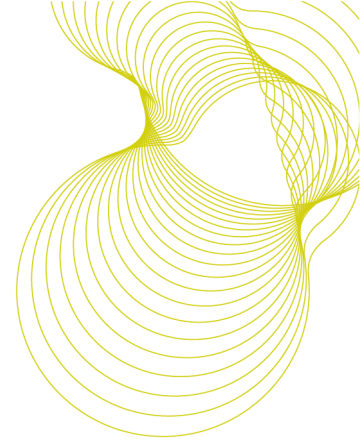

## 4 Test specimen

The general details about the test specimen supplied by Smart Architectural Aluminium for these tests are given below:

- Type:** Aluminium frame members with glazed leafs; one fixed and the other sliding. Reference: Smart Systems Slide 2000 sliding patio door; specimen is 2210 mm wide x 2200 mm high. Drawings and photographs in the Annex of this report show cross sections of the frame members and door details.
- Frame:** Aluminium sections.
- Glazing:** The leafs are glazed with insulating glass units with 4 mm thick toughened glass, a 20 mm wide air gap and 4 mm thick toughened glass. Aluminium members retain the glazing and the glazing seals.
- Seals:** Brush type seals on the sliding door leaf.
- Hardware:** ACGSL 1174 lock and keep set and ACSL 180 handle set. The sliding leaf runs on ACGSL 054 adjustable double roller set.
- Drainage:** There are slots in the threshold and two in the outer face of the leaf. There is a weather hood over the top most horizontal opening joint.
- Fixings:** For these tests the specimen was fixed with screws and sealed into a timber surround frame.
- Dimensions:** 2210 mm wide x 2200 mm high (overall). Area: 4.86 m<sup>2</sup>  
Length of opening joint = 4.28 m

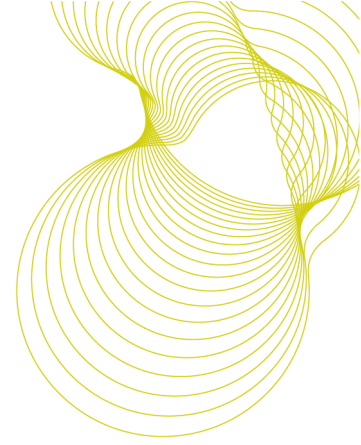

## 5 Test rig and preparatory procedures

The test specimen was conditioned for at least 4 hours within temperature and humidity ranges specified in the test standards of 10°C to 30°C and 25% to 75% RH respectively.


The water temperature in the watertightness test was within the specified range of 4°C to 30°C.

The specimen was mounted in the BRE test rig 'G', to form one wall of a pressure box, with the outdoor face enclosed in the box.

A spray bar with five full circular cone nozzles was mounted in the pressure box to apply water to the outside face of the specimen. The water flow rate per nozzle was 2 L/min in accordance with BS EN 1027 spraying method 1A.

Transducers were mounted on independent supports to measure deflections of a frame member. Deflections were measured on the span at the positions indicated in Figure A3.



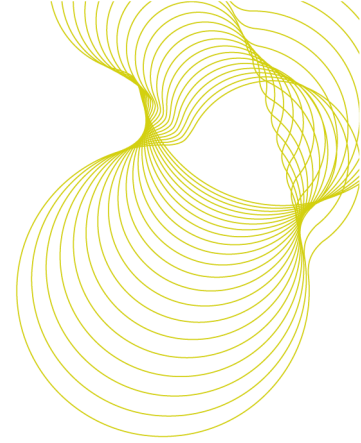


## 6 Summary of test results

The test results are summarised in Table 1 below. Figures show detail of the Slide 2000 sliding patio door and detailed results are given in Annex A.

| BS      | Air permeability             |  | Watertightness     |   | Resistance to wind loads                                |   |
|---------|------------------------------|--|--------------------|---|---|---|
|         | Requirements                 | Results  | Requirement        | Results                                   | Requirements  | Results   |
| BS 6375 | Class 3 or Class 4 at 600 Pa | <b>Met the requirements</b> of Class 3 for the average of positive and negative test results | Class 5A at 200 Pa | Class 7A at 300 Pa<br><b>Met Class 5A</b> | Class A4<br>P1 = 1600 Pa<br>P2 = 800 Pa<br>P3 = 2400 Pa | <b>Met all of the requirements</b> for Class A4 |


**Table 1. Summary of weathertightness test results**

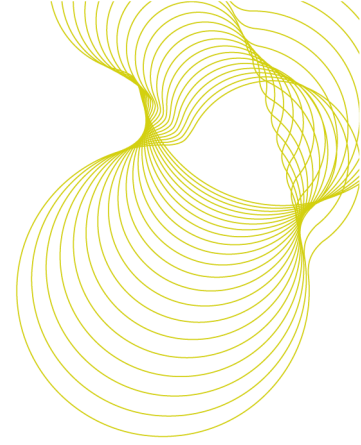

## 7 Conclusions


When the specimen Smart Architectural Aluminium Slide 2000 sliding patio door 2210 mm wide x 2200 mm high was tested to the standards described herein to a UK exposure category '1600' it was found to be:

- Sufficiently airtight to attain Class 3 based on the averages of results under positive and negative test pressures thus meeting the BS 6375: Part 1: 2009 requirements for Class 3 at 600 Pa.
- Resistant to water penetration using method 1A to Class 7A up to and at 300 Pa thus meeting the BS 6375: Part 1: 2009 requirements for Class 5A at 200 Pa. Also meets the Class 7A requirement up to and at 300 Pa in BS EN 12208.
- Resistant to wind loads of  $\pm 1600$  Pa causing deflections less than 1/150 of the span of a frame member. Resistant to repeated pressure cycles of  $\pm 800$  Pa and able to sustain the corresponding safety test pressure of  $\pm 2400$  Pa. The overall classification for resistance to wind load is Class A4 thus meeting the requirements of BS 6375: Part 1: 2009.

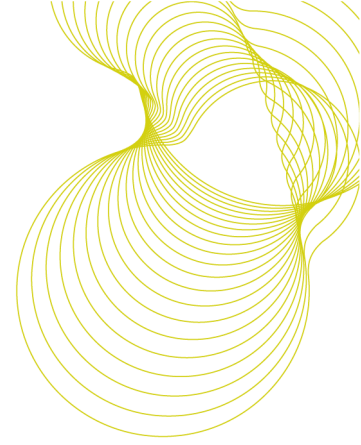

## 8 References

1. BS EN 1026: 2000. Windows and doors – Air permeability – Test method. British Standards Institution, London.
2. BS EN 1027: 2000. Windows and doors – Watertightness – Test method. British Standards Institution, London.
3. BS EN 12211: 2000. Windows and doors – Resistance to wind load – Test method. British Standards Institution, London.
4. BS 6375: Part 1: 2009. Performance of windows and doors – Classification for weathertightness and guidance on selection and specification
5. BS EN 12207: 2000. Windows and doors – Air permeability - Classification. British Standards Institution, London.
6. BS EN 12208: 2000. Windows and doors – Watertightness - Classification. British Standards Institution, London.
7. BS EN 12210: 2000. Windows and doors – Resistance to wind load - Classification. British Standards Institution, London.
8. BS EN 14351-1:2006 Windows and doors – Product standard. British Standards Institution, London.

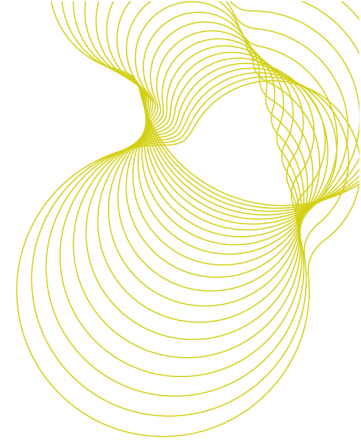

## ANNEX A. Weathertightness test results

| Pressure differential Pa | Air flow through the specimen m <sup>3</sup> /h | Air flow per unit area of the specimen m <sup>3</sup> /h.m <sup>2</sup> | Air flow per m of opening joint on the specimen m <sup>3</sup> /h.m |
|--------------------------|---|---|---|
| 50                       | 12.15   | 2.50  | 2.84  |
| 100                      | 16.84   | 3.46  | 3.94  |
| 150                      | 23.68   | 4.87  | 5.54  |
| 200                      | 30.65   | 6.30  | 7.17  |
| 250                      | 36.23   | 7.45  | 8.47  |
| 300                      | 33.08   | 6.80  | 7.74  |
| 450                      | 42.46   | 8.73  | 9.93  |
| 600                      | 48.24   | 9.92  | 11.28   |



**Table A1. Air permeability under positive air pressure; test results**

| Pressure differential Pa | Air flow through the specimen m <sup>3</sup> /h | Air flow per unit area of the specimen m <sup>3</sup> /h.m <sup>2</sup> | Air flow per m of opening joint on the specimen m <sup>3</sup> /h.m |
|--------------------------|---|---|---|
| 50                       | 16.65   | 3.42  | 3.89  |
| 100                      | 22.85   | 4.70  | 5.34  |
| 150                      | 30.28   | 6.23  | 7.08  |
| 200                      | 35.15   | 7.23  | 8.22  |
| 250                      | 40.08   | 8.24  | 9.38  |
| 300                      | 35.29   | 7.26  | 8.25  |
| 450                      | 48.79   | 10.03   | 11.41   |
| 600                      | 54.87   | 11.29   | 12.84   |


**Table A2. Air permeability under negative air pressure; test results**

| Pressure differential Pa | Average air flow per unit area of the specimen m <sup>3</sup> /h.m <sup>2</sup> | Average air flow per m of opening joint on the specimen m <sup>3</sup> /h.m |
|--------------------------|---|---|
| 50                       | 2.96  | 3.37  |
| 100                      | 4.08  | 4.64  |
| 150                      | 5.55  | 6.31  |
| 200                      | 6.78  | 7.70  |
| 250                      | 7.85  | 8.93  |
| 300                      | 7.03  | 8.00  |
| 450                      | 9.38  | 10.67   |
| 600                      | 10.61   | 12.06   |

**Table A3. Averages of air permeabilities under positive and negative air pressures; test results**

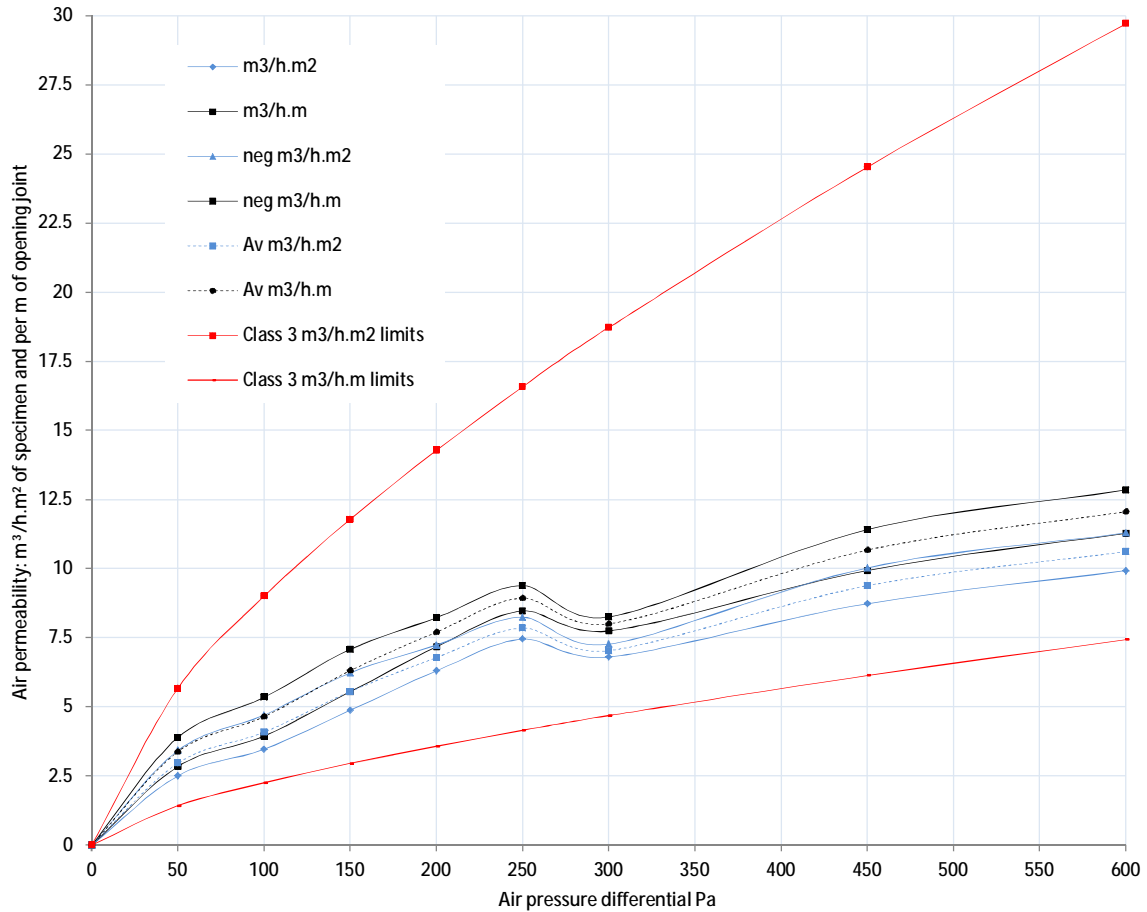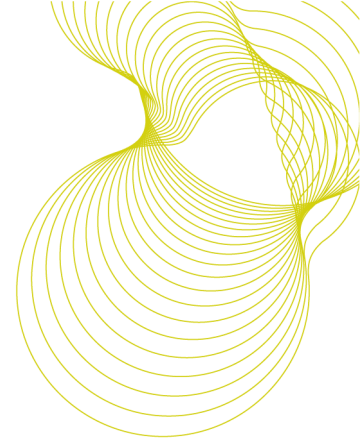

**Figure A1. Test results: Air permeability under positive and negative air pressure; showing limits and averages of air permeabilities measured under positive and negative test pressures**

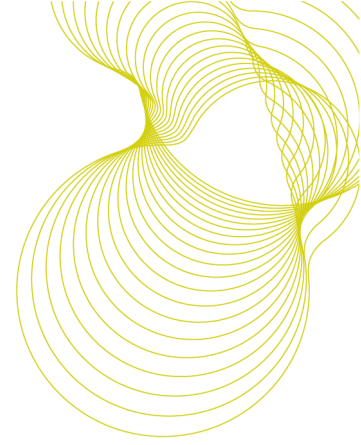

**Watertightness test**

| Pressure differential<br>Pa | Duration<br>Minutes | Water leaks |
|-----------------------------|---------------------|-------------|
| 0                           | 15                  | Nil         |
| 50                          | 5                   | Nil         |
| 100                         | 5                   | Nil         |
| 150                         | 5                   | Nil         |
| 200                         | 5                   | Nil         |
| 250                         | 5                   | Nil         |
| 300                         | 5                   | Nil         |

Test laboratory conditions: Air temperature 19°C. Test chamber air temperature 19.3°C  
Air pressure 1015.9 mb. Relative humidity 44% at 19°C. Water temperature 17°C


**Table A4. Watertightness test results**

**Resistance to wind load – Deflection test at ± 1600 Pa**

| Position<br>deflection<br>measured   | Positive pressure<br>P1 to +1600 Pa |            | Negative pressure<br>P1 to -1600 Pa |            |
|--------------------------------------|-------------------------------------|------------|-------------------------------------|------------|
|                                      | Deflection                          |            | Deflection                          |            |
|                                      | mm                                  | defl./span | mm                                  | defl./span |
| Centre<br>mullion on<br>sliding leaf | 6.37                                | 1/333      | 5.75                                | 1/369      |

**Note:** The deflection at the mid-point of a member is measured relative to its ends, e.g. with reference to Figure A3: Deflection at the mid-point = deflection at the mid-point – average of deflections at the two ends of the same member.

**Table A5. Deflections measured on a frame member in the resistance to wind load test at ±1600 Pa.**

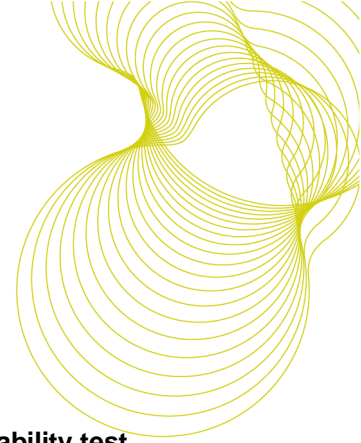

**Resistance to wind load – Repeated pressure test including the second air permeability test**

|                                 |                              |
|---------------------------------|------------------------------|
| Repeated pressure               | Damage or functional defects |
| 50 cycles to P2 at $\pm 800$ Pa | None                         |

**Table A6. Damage or functional defects after repeated pressures to P2 at  $\pm 800$  Pa**

**Second air permeability test under positive air pressures (part of resistance to wind load test)**


| Pressure differential<br>Pa | Air flow through the specimen<br>m <sup>3</sup> /h | Air flow through specimen measured at first air permeability test<br>m <sup>3</sup> /h | Comparison to the air permeability measured previously (see Table A1)  |
|-----------------------------|--|--|--|
| 50                          | 12.64  | 12.15  | After the test pressures P1 and P2 were applied the amounts of air flowing through the test specimen were not significantly different to those measured previously |
| 100                         | 17.18  | 16.84  |  |
| 150                         | 24.20  | 23.68  |  |
| 200                         | 31.19  | 30.65  |  |
| 250                         | 36.49  | 36.23  |  |
| 300                         | 33.50  | 33.08  |  |
| 450                         | 43.20  | 42.46  |  |
| 600                         | 49.41  | 48.24  |  |

**Table A7. Second air permeability test results under positive air pressures**

**Second air permeability test under negative air pressures (part of resistance to wind load test)**

| Pressure differential<br>Pa | Air flow through the specimen<br>m <sup>3</sup> /h | Air flow through specimen measured at first air permeability test<br>m <sup>3</sup> /h | Comparison to the air permeability measured previously (see Table A2)  |
|-----------------------------|--|--|--|
| 50                          | 17.03  | 16.65  | After the test pressures P1 and P2 were applied the amounts of air flowing through the test specimen were not significantly different to those measured previously |
| 100                         | 23.19  | 22.85  |  |
| 150                         | 30.50  | 30.28  |  |
| 200                         | 35.66  | 35.15  |  |
| 250                         | 40.73  | 40.08  |  |
| 300                         | 36.23  | 35.29  |  |
| 450                         | 49.20  | 48.79  |  |
| 600                         | 57.59  | 54.87  |  |

**Table A8. Second air permeability test results under negative air pressures**

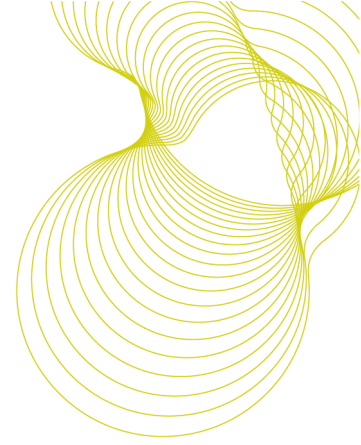

**Resistance to wind load - Safety test**

| Safety test  | Condition after test   |
|--|--|
| One pressure pulse to pressure: P3 at – then + 2400 Pa | No parts became detached and the test specimen remained closed |

**Table A9. Condition of the specimen after the safety test to P3 at ±2400 Pa**



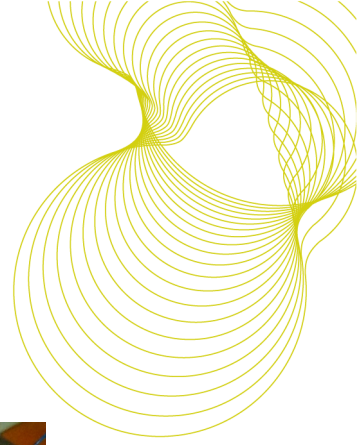


Figure A2. The test specimen installed in the BRE 'G' Weathertightness test rig




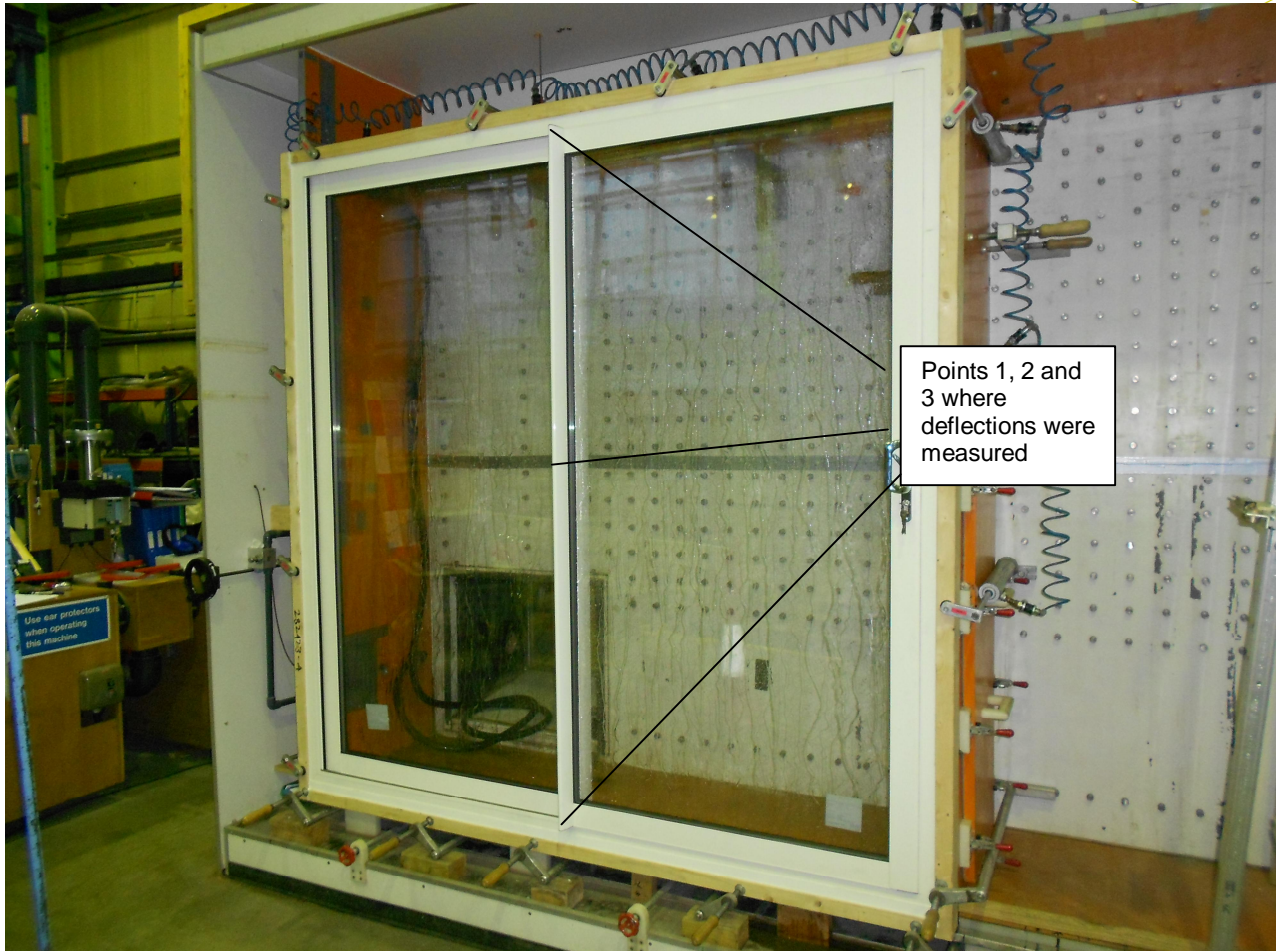


Figure A3. The test specimen showing points 1, 2 and 3 where deflections were measured.

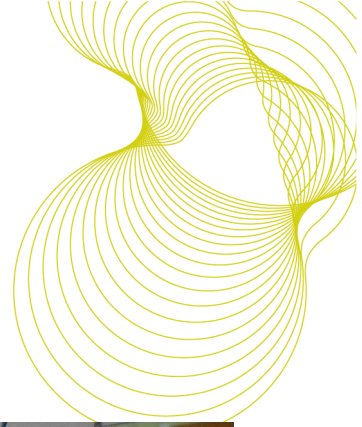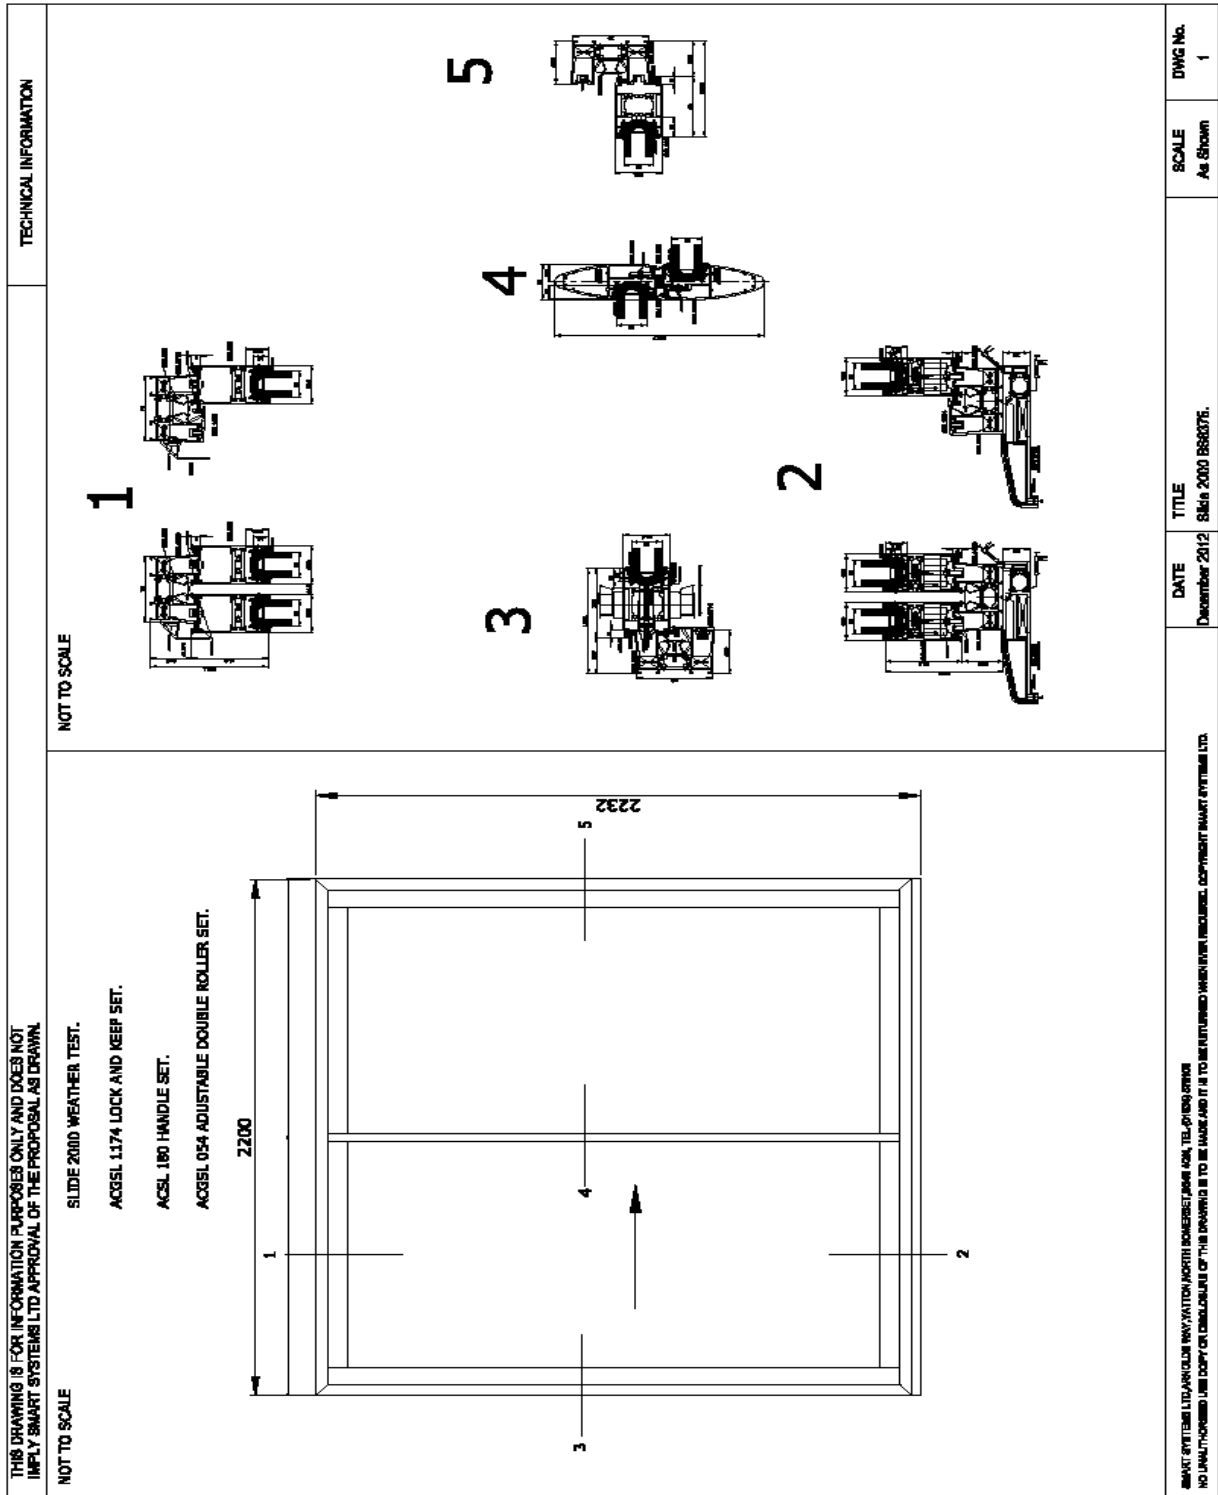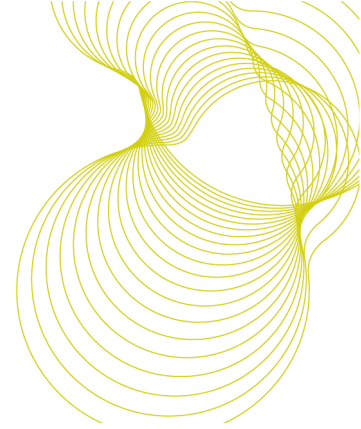

=====REPORT ENDS=====